NOTES	UNLESS OTHERWISE SPECIFIED
1	GREEN WIRE IS SUPPLIED WITH A 5/16 INSULATED RING TERMINAL.
2	BLACK WIRE IS SUPPLIED WITH A #10 INSULATED RING TERMINAL.
3	POWER UNIT IS CHASSIS GROUNDED. MOUNTING SURFACE MUST BE CLEAN AND FREE OF PAINT.

CHANGE LETTER	C.O.	DESCRIPTION	DATE	BY

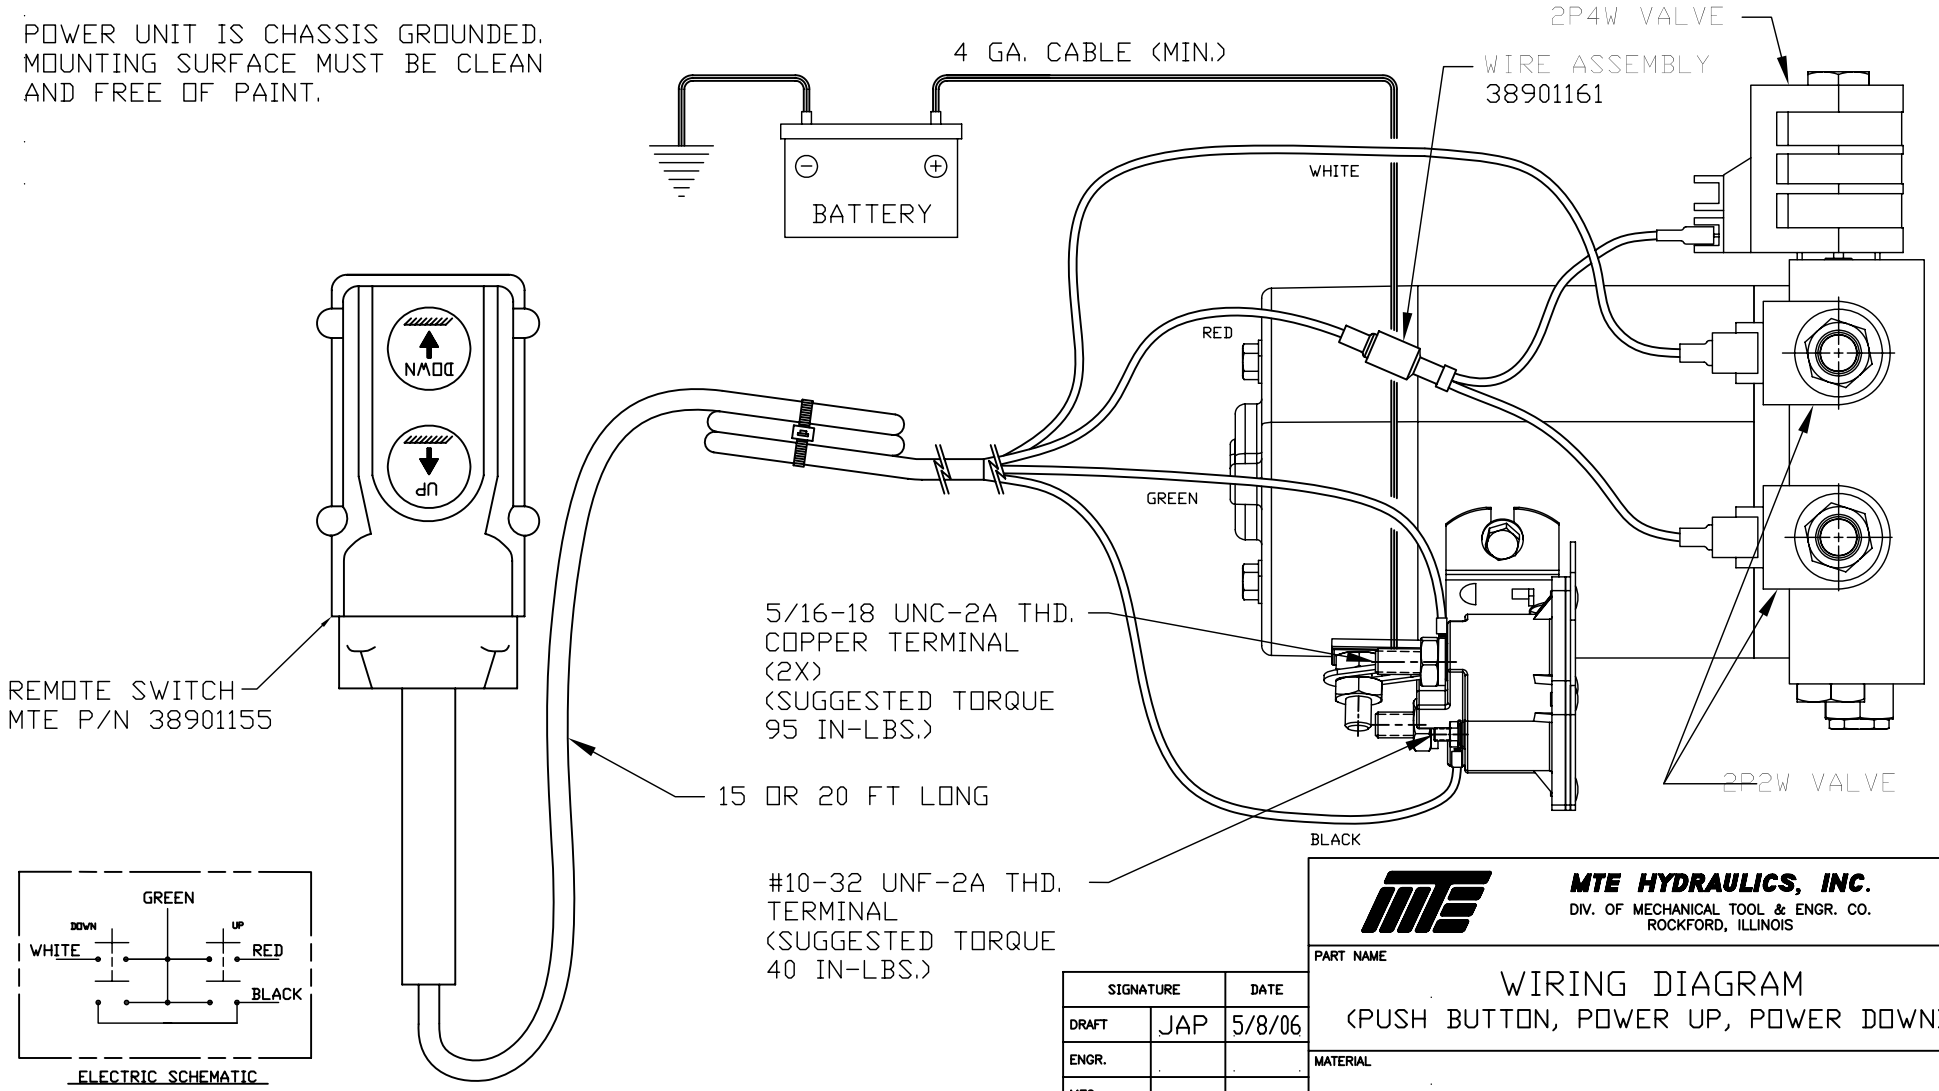

ELECTRIC SCHEMATIC

SIGNATURE		DATE
DRAFT	JAP	5/8/06
ENGR.		
MFG.		
RELEASE	ECO	9443
SPEC. NO.	5010,5011	

NOTICE – THIS PRINT CONTAINS PROPRIETARY INFORMATION AND IT IS FURNISHED SUBJECT TO THE EXPRESS CONDITION THAT IT WILL NOT BE USED IN ANY WAY DETRIMENTAL TO MTE HYDRAULICS INC.

MTE HYDRAULICS, INC.
DIV. OF MECHANICAL TOOL & ENGR. CO.
ROCKFORD, ILLINOIS

PART NAME
WIRING DIAGRAM
(PUSH BUTTON, POWER UP, POWER DOWN)

MATERIAL

HEAT TREAT | HARDNESS

DATE 5/8/06 | DRAWING NUMBER 39901192 | REVISION

SCALE NONE